



Proceedings of the
International Fire Safety
Symposium 2015

Organizers:

**cib - International Council for Research and
Innovation in Building Construction**

UC - University of Coimbra

albrasci - Luso-Brazilian Association for Fire Safety

Editors:

João Paulo C. Rodrigues

George V. Hadjisophocleous

Luís M. Laím

Hélder D. Craveiro

**Coimbra, 20-22 April, 2015
Portugal**

Proceedings of the International Fire Safety Symposium 2015

Organizers:

CIB - International Council for Research and Innovation in Building Construction
UC - University of Coimbra
ALBRASCI - Luso-Brazilian Association for Fire Safety

Authors:

João Paulo C. Rodrigues
George V. Hadjisophocleous
Luís M. Laím
Hélder D. Craveiro

Proceedings of the International Fire Safety Symposium 2015

held at the Department of Civil Engineering of the University of Coimbra, Portugal
20th-22nd April 2015

ISBN 978-989-98435-5-4

ISSN 2412-2629

A Symposium organised by



International Council
for Research and Innovation in
Building and Construction
(www.cibworld.nl)

• U



C •

University of Coimbra
(www.uc.pt)



ALBRASCI
Luso-Brazilian Association
for Fire Safety
(<http://www.albrasci.com>)

All rights reserved. No part of the publication may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopied, recording or otherwise, without prior permission of the Publisher.

No responsibility is assumed by the Publisher for any injury and/or damage to people or property as a matter of products liability, negligence or otherwise, or from any use or operation of any methods, products, instructions or ideas contained in the materials herein.

PREFACE

On behalf of the Organising and Scientific committees, as well as the CIB W-14 Commission on Fire Safety it is our pleasure to welcome you to the International Fire Safety Symposium - IFireSS 2015, which is organised by the CIB's Commission W14-Fire Safety, ALBRASCI and University of Coimbra. The Symposium aims to contribute to the exchange of ideas and knowledge in the area of Fire Safety and assist in planning future research activities in this area.

CIB W14-Fire Safety is a Working Commission of CIB (International Council for Research and Innovation in Building & Construction) and its main objectives are:

- To create an ongoing research and innovation focus for the development of a comprehensive, coherent, rational and empirical basis for a safe and sustainable built environment, which includes fire science and engineering practices and design methodologies;
- To promote the acceptance of Fire Science and Engineering Practices, Procedures and Design Methodologies worldwide, and to encourage their use in Building and Fire Safety Legislation, Codes, Regulations and Standards;
- To provide technical input, from a Fire Science and Engineering Perspective, to other relevant CIB Working Commissions and Task Groups;
- To facilitate the transfer of state-of-the-art Fire Science and Engineering Technology at international level;
- To encourage capacity building for Fire Science and Engineering worldwide.

The Luso-Brazilian Association for Fire Safety (ALBRASCI) was established recently by Portuguese and Brazilian specialists in the area of Fire Safety to create a platform for the development of Fire Safety in Portugal and Brazil.

The University of Coimbra (UC) is a reference in higher education and research in Portugal, due to the quality of the courses taught and to the advances achieved in pure and applied research in various areas of knowledge. UC is also well-known around the World due to the research and training in Fire Safety with an MSc and PhD in the area.

The Symposium has participants from researchers around the world and covers a wide variety of research areas including: Structural Fire Safety; Mechanical and Thermal Properties of Materials; Fire Chemistry, Physics and Combustion; Fire Reaction; Fire Safety in Vehicles and Tunnels; Fire Risk Assessment; Smoke Control Systems; Firefighting and Evacuation; and Fire Regulations, Standardization and Construction Trends.

Joao Paulo C Rodrigues
President of the Organizing Committee

George Hadjisophocleous
President of the Scientific Committee

**FIRE REACTION OF CONCRETE WITH AND WITHOUT PP FIBRES:
EXPERIMENTAL ANALYSIS AND NUMERICAL SIMULATION**



Paulo Piloto*
Professor
Poly. Inst. Bragança
Portugal



Luís M.R. Mesquita
Professor
Poly. Inst. Bragança
Portugal



Carlos Balsa
Professor
Poly. Inst. Bragança
Portugal

ABSTRACT

This work investigates the thermal behaviour of concrete samples under controlled test conditions for heat flux (35 kw/m^2 and 75 kw/m^2) and the validation of a numerical simulation model, by comparison of the temperature measurements in different positions. It also aims to assess the reaction to fire of different concrete samples with their natural components and with the addition of polypropylene fibres using two densities (600 and 1200 g/kg), measuring the mass loss (m/m_0), mass loss rate (MLR), heat release rate (HRR) and total heat release (THR) using a cone calorimeter operating with EN ISO 13927 specifications [1]. The results demonstrate that the thermal behaviour is independent of the amount of the fibre density, for both incident heat fluxes. The validation of the numerical model was determined using two different solution methods (finite element and finite difference).

Keywords: Fire reaction; Concrete; PP fibres; Thermal performance; heat release rate.

* Corresponding author – Department of Applied Mechanics, Polytechnic Institute of Bragança. Campus Santa Apolónia, ap. 1134, 5301-857 Bragança. PORTUGAL. Telef.: +351 273 303157 Fax: +351 273 313051. e-mail: ppiloto@ipb.pt

1. INTRODUCTION

Structural elements of reinforced concrete, in general, present good performance in case of fire. However, more recent structures have adapted new types of concrete (high strength, self-compacting, etc.) presenting different thermomechanical behaviour, acquiring special importance the study of spalling. One of the most common procedure to minimize this event is the addition of polypropylene fibres (PP) to natural components (AN), reducing the internal void pressure of the material through the channels created by fusion of the fibres.

The experimental study of concrete under fire conditions and the development of numerical models has allowed the assessment of more or less complex phenomena to determine temperature evolution and other state variables, enabling different levels of approaches, using coupled or uncoupled field interaction (thermal, mechanical, hydrodynamic, chemical). This investigation studies the thermal performance of a numerical model, using nonlinear and transient thermal analysis.

The experimental methodology is based on the test of fire reaction using a cone calorimeter and a thermopile on small scale samples using the recommended test method EN ISO 13927 [1] . Apart from the standardized test, thermocouples were used in different positions of the samples to evaluate the thermal performance. This procedure was used for the validation of the numerical model, assessing the effect of polypropylene fibre density and the effect of incident heat flux.

2. MATERIALS AND METHODS


Natural samples of concrete (AN) were prepared with siliceous-based aggregates. The ratio of water cement was 45%, and for 1 m³ of concrete, a mass of sand 1322.7 [kg] was used. The mass of aggregate was 451.1 [kg], with a water volume of 198 [l] and a cement content of 466.7 [kg]. The aggregates were characterized according NP EN 933-1 [2], wherein the proportion of aggregates with a diameter between 4 and 6 mm was 90%, while the percentage of sand with a diameter between 0.063 and 0.5 mm was 80%. Polypropylene fibres (PP) fibril BIU 12mm were used with two densities: 600 and 1200 g/m³ of concrete. The fibres have an average length of 12 mm, received special hydrophilic treatment in order to achieve optimum dispersion in the concrete, causing a three-dimensional material structure [3]. This feature reduces the formation of cracks by shrinkage, decreases the porosity and permeability of concrete at ambient temperature, and increases the abrasion resistance, durability and ductility [3]. The behaviour at elevated temperatures could significantly increase the porosity, avoiding spalling. Figure 1 represents the moment of addition of the fibres and filling of the moulds.



Figure 1: Preparation of concrete samples with PP fibres.

The dimension of each sample was 100x100x40 mm and all samples were conditioned for 28 days in a wet chamber, with 95% humidity at 20 °C. All samples were weighed and drilled for insertion of four K-type thermocouples (T1, T2, T3 and T4). The hot junction of thermocouples were located at the central position, according to Figure 2.

The exposed surface of the samples was maintained at a distance of 25 [mm] from cone calorimeter base. The calibration was performed to the each specified radiant heat flux, using the heat flux meter, resulting in a temperature of the electrical resistance cone of 713 and 923 [°C], for heat the flux of 35 and 75 [kW/m²], respectively. The thermopile was calibrated by burning methane (purity > 99.5%) with different flow mass.

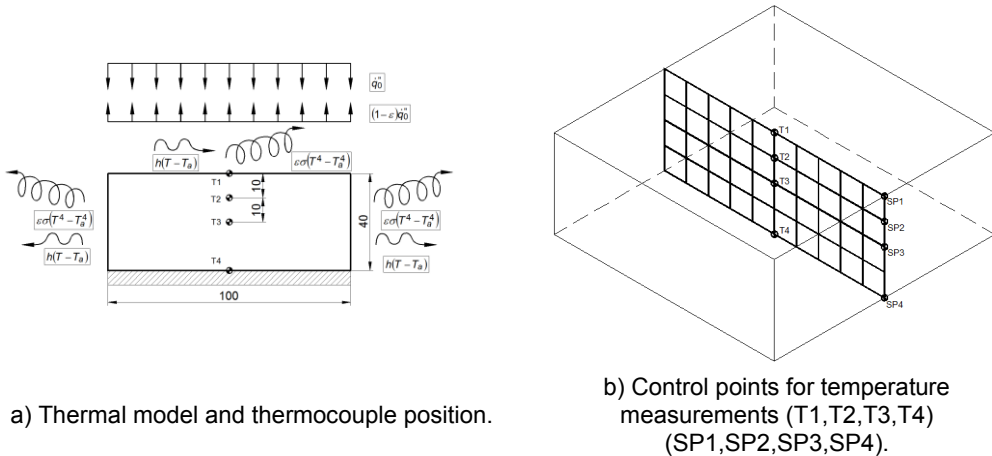

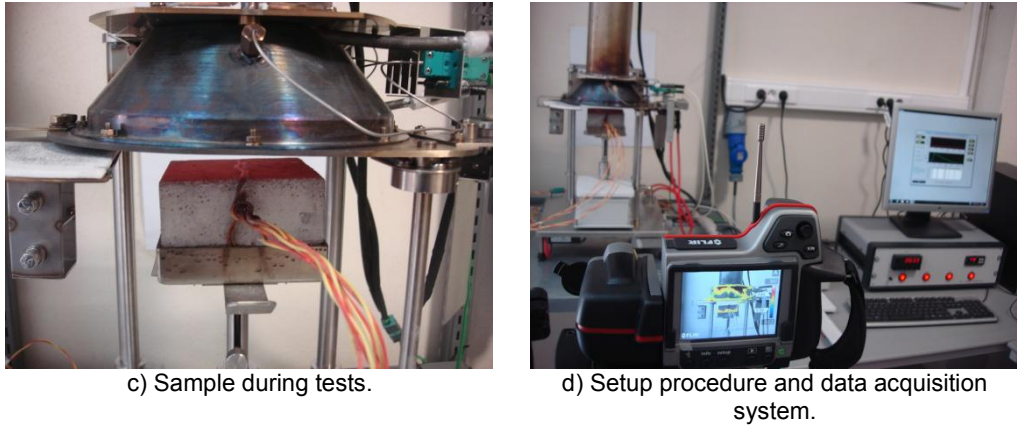


Figure 2: Test model and instrumentation.

Table 1 identifies and characterizes all tested samples. Small changes to standard test procedure was made, in order to validate the numerical model.

Table 1: Tested samples.

| Samples | Materials | Heat flux [kW/m^2] |
|----------|----------------------------------|-------------------------------|
| 01 | AN | 35 |
| 02 | AN | 35 |
| 03 | AN | 75 |
| BF1_600 | AN + PP [600 g/m ³] | 35 |
| BF2_600 | AN + PP [600 g/m ³] | 75 |
| BF1_1200 | AN + PP [1200 g/m ³] | 35 |
| BF2_1200 | AN + PP [1200 g/m ³] | 75 |

Experimental tests were performed with multiple data acquisition systems. The cone calorimeter has the ability to measure weight loss, heat release and their time derivatives. The HBM MGCplus system was used to acquire temperature in central points (T1, T2, T3 and T4) and the infrared thermography was used to characterize the temperature field and particularly the evolution of temperature in lateral control points (SP1, SP2, SP3 and SP4). This thermography system (FLIR T365) has a multi scale measuring range (-20 to +120 ° C), (0 to +350 ° C) and (+200 to +1200 ° C).

The thermal performance of the samples depends on the thermal balance in the boundaries. Eq. 1 should be solved in the two dimensional domain of the sample (Ω), taking into account the exchange of heat with the surroundings ($\partial\Omega_i$). On the top exposed surface of the sample ($\partial\Omega_1$), the heat flow balance (input and output) should verify Eq. 2. The net incident heat flux at

the top surface of the sample is composed by the heat flux coming from the cone heater, radiation reflected from the surface, convective and radiative heat losses. On the lateral surfaces of the sample ($\partial\Omega_2$) the convective and radiative heat losses must be considered by Eq. 3 and at the bottom surface of the domain ($\partial\Omega_3$) the adiabatic condition may be assumed, Eq. 4. In these equations T represents the main state variable (temperature). The nonlinear thermal properties of concrete are represented by the specific mass of normal concrete $\rho(T)$, by the specific heat $C_{p(T)}$ for a moisture content of 3% of concrete weight and by the upper limit of thermal conductivity $\lambda(T)$, all in accordance to EN1992-1-2 [4]. The emissivity of concrete ε was considered equal to 0.7. The Stefan-Boltzmann coefficient is denoted by σ and h represents the convection coefficient that was approximated by an experimental correlation for a hot horizontal plate in air, with the hot surface uppermost [5]. T_a represents the ambient temperature.

$$\nabla \cdot (\lambda(T) \cdot \nabla T) = \rho(T) \cdot C_{p(T)} \cdot \partial T / \partial t \quad (\Omega) \quad (1)$$

$$(\lambda(T) \cdot \nabla T) \cdot \vec{n} = \dot{q}_0'' - h(T - T_a) - \varepsilon \sigma (T^4 - T_a^4) - (1 - \varepsilon) \dot{q}_0'' \quad (\partial\Omega_1) \quad (2)$$


$$(\lambda(T) \cdot \nabla T) \cdot \vec{n} = -h(T - T_a) - \varepsilon \sigma (T^4 - T_a^4) \quad (\partial\Omega_2) \quad (3)$$

$$(\lambda(T) \cdot \nabla T) \cdot \vec{n} = 0 \quad (\partial\Omega_3) \quad (4)$$


The numerical simulation model was performed with ANSYS and with OCTAVE.

3. EXPERIMENTAL TESTS


The thermal behaviour of the samples is represented in Figure 3, for all samples submitted to 35 and 75 kW/m². Time temperature evolution is represented for central and lateral control points. The infrared temperature field is also represented for 10 and 60 minutes. Temperature measurement on the top surface (thermocouple T1) requires another type of experimental validation, taking into account that the hot junction of the thermocouple was placed in contact with the surface but simultaneously exposed to heat flux coming from cone calorimeter. The remaining temperature measurements are considered more accurate (T2, T3 and T4), since they were acquired inside the material. The infrared measurement was performed at a distance of 1.1 m, between the camera and the sample.

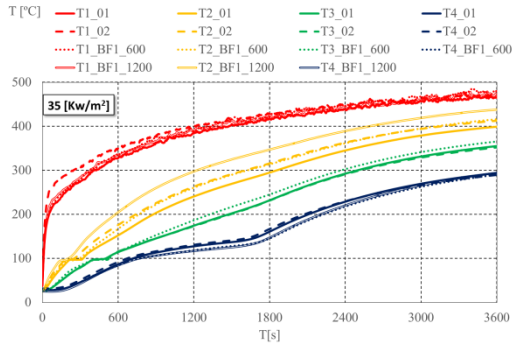


a) Thermocouple measurements at central points (T1, T2, T3 and T4).

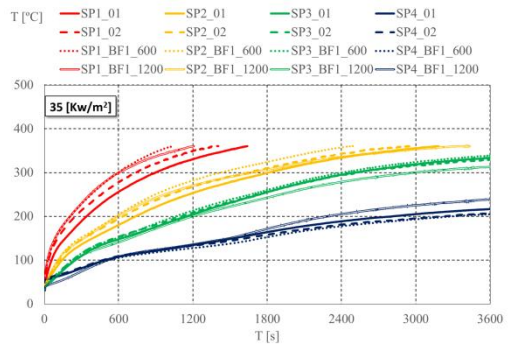


b) Infrared measurements at lateral points (SP1, SP2, SP3 and SP4).

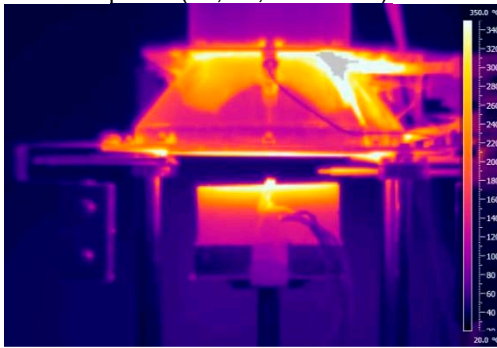


c) Infrared thermography, BF1_1200, t=600 s.

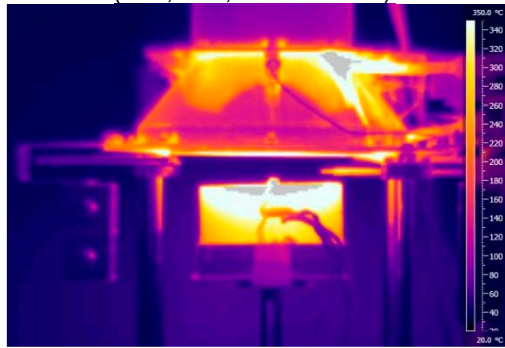

d) Infrared thermography, BF1_1200, t=3600 s.

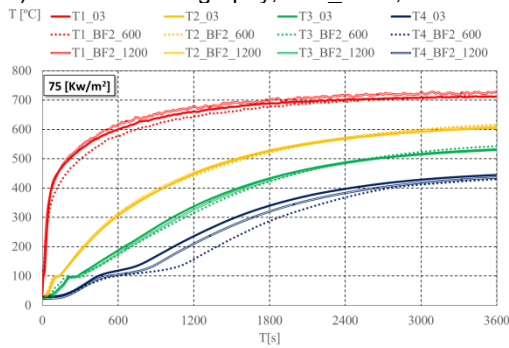

e) Thermocouple measurements at central points (T1, T2, T3 and T4).

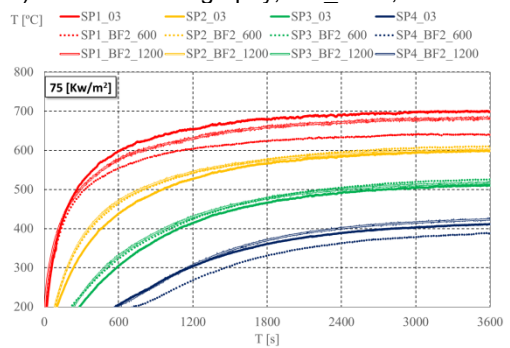

f) Infrared measurements at lateral points (SP1, SP2, SP3 and SP4).

Figure 3: Thermal performance of samples.

The reaction of the material to the heat flux of 35 and 75 [kW/m²] was determined according to the mass loss of the sample, mass loss rate, heat release rate and total heat released during each test. The mass loss of samples submitted to 35 [kW/m²] present a bilinear characteristic behaviour, defined in two periods (the first period with 0.03 [g/s] and the second period with 0.005 [g/s]). Samples submitted to 75 [kW/m²] presented higher mass loss rate at the beginning of the test, affecting the shape of the mass loss curve, as represented in Figure 4. The heat release rate appears to be independent of the amount of PP fibres existing in the samples, depending only on the incident heat flux, see Figure 4.

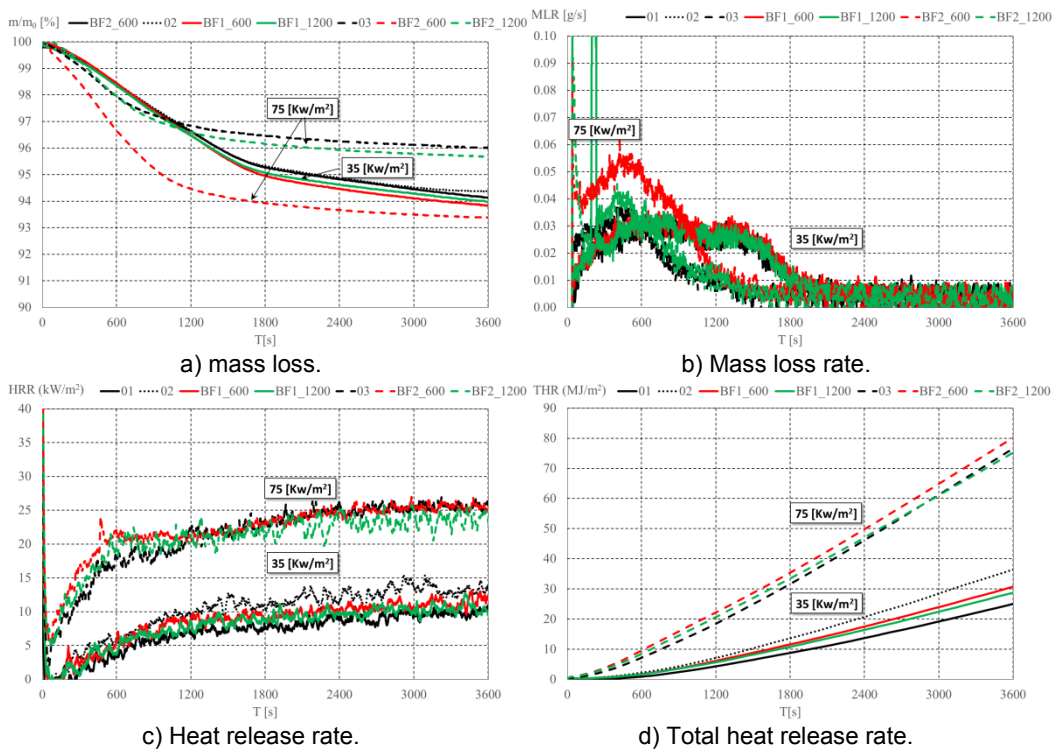


Figure 4: Mass loss and heat release.

4. NUMERICAL SIMULATION

The convergence analysis of the solution was verified in the previous author's work [6]. This section presents the results for 1D and 2D analysis, using finite element and finite difference methods.

4.1 Finite Element Method (2D)

The first model was defined in ANSYS. This model uses plane elements with 4 nodes (PLANE55) and one (1) degree of freedom per node, linear interpolating functions and four (4) integration points (2x2) to determine the conductivity matrix. Taking into account the limitation of this element for applying simultaneous boundary conditions (heat flux and convection at the exposed surface), an auxiliary model was created. This auxiliary model presents low heat storage capacity and high thermal conductivity ($\rho(T) = 1 \text{ kg/m}^3$, $C_{p(T)} = 1 \text{ J/kgK}$, $\lambda(T) = 1000 \text{ W/m}^2\text{K}$). The interface between the principal mesh (sample) and the auxiliary mesh was established by contact finite elements (COMBINE 39), using high thermal conductance $100000 \text{ W/m}^2\text{K}$. The net heat fluxes $\dot{q}_0'' = 24.5$ and $\dot{q}_0'' = 52.5 \text{ [kW/m}^2\text{]}$ were applied at the top surface of the auxiliary mesh, while the convection and radiation boundary conditions were applied at the top surface and lateral surface of the main mesh sample. The adiabatic condition was applied at the bottom surface of the model and the initial temperature condition was applied to every node (27 °C), see Figure 5. The numerical results are similar for both heat fluxes, despite the level of temperature.

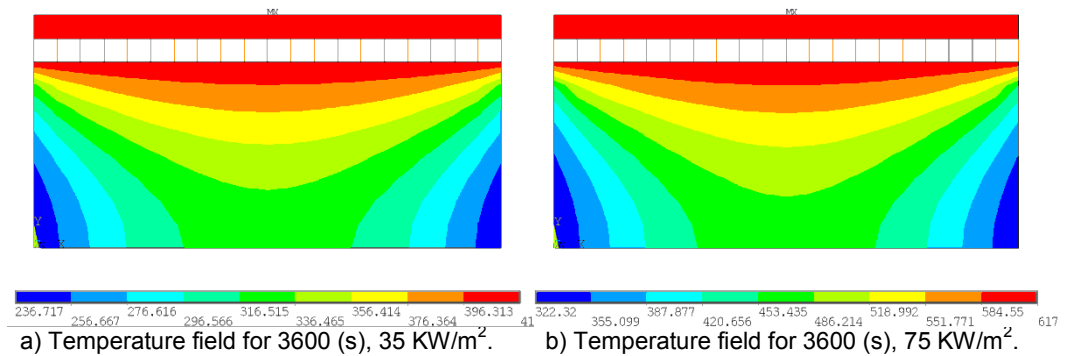


Figure 5 – Temperature field on both samples submitted to 35 and 75 KW/m^2

A comparison of the numerical solution with measurements of the thermocouples (T1, T2, T3 and T4) and with measurements of infrared thermography (SP1, SP2, SP3, and SP4) is represented in Figure 6. Good approximation was achieved for the simulation results at central points, with exception of measurement T1. The simulation results differs considerably from infrared thermal results in the lateral points, for both incident heat fluxes in general, but for higher incident heat flux in particular.


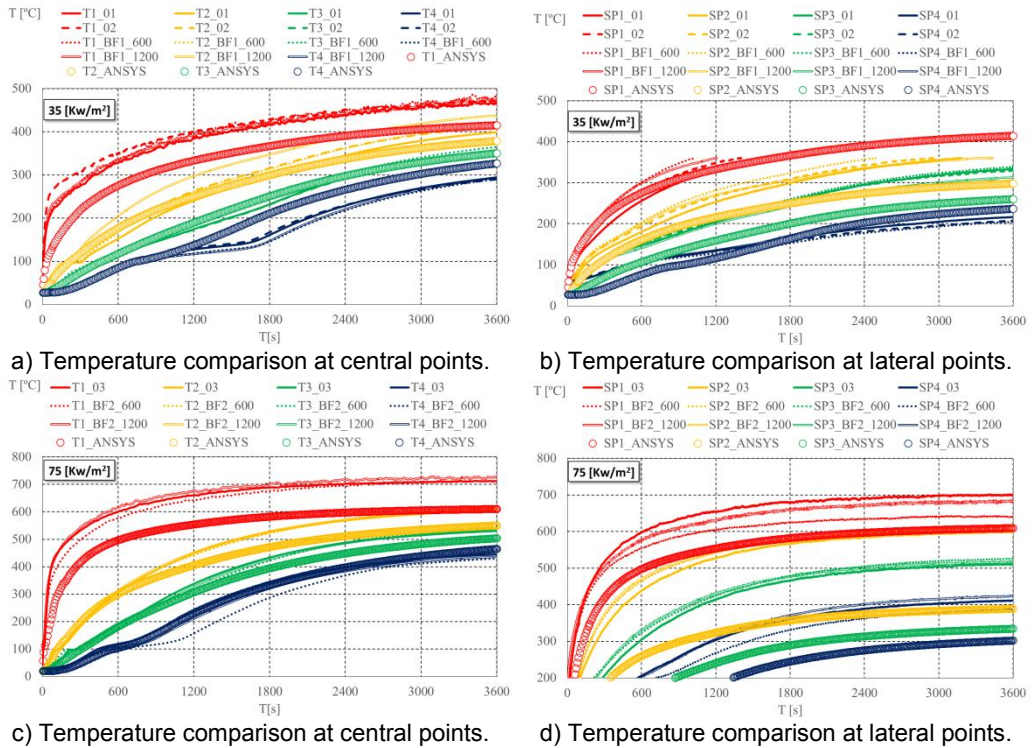


Figure 6 – Comparison between experimental and finite element results (2D).

4.2 Finite Difference Method (1D and 2D)

Both 1D and 2D finite difference models were defined with equal spacing grids. The time increment used an implicit scheme with a constant time-step equal to 1 s. A regular grid finite difference was defined with equally spaced points. The scientific computing was implemented in OCTAVE. The convergence of the solution was also verified to 35 [kW/m²]. The 1D model does not consider any kind of heat flux in horizontal direction, so the temperature results of the 1D model should be higher than the results of 2D model, see Figure 7.

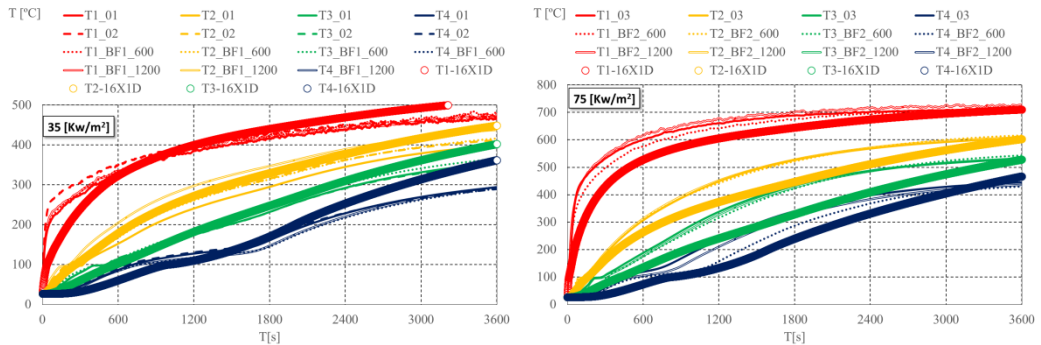

a) Temperature comparison at central points. b) Temperature comparison at central points
Figure 7: Temperature comparison using finite difference method.

5. CONCLUSIONS

A total of seven (7) concrete samples were tested in a cone calorimeter to analyse the thermal effect of polypropylene fibres and the effect of two incident heat fluxes. The results demonstrate that the thermal behaviour is independent of the amount of the fibre density, for both incident heat fluxes. The validation of the numerical model was determined using two different solution methods (finite element and finite difference).

6. REFERENCES

- [1] CEN, EN ISO 13927. Plastics – Simple heat release test using a conical radiant heater and a thermopile detector. Brussels: CEN - Comité Européen de Normalisation.” 2003.
- [2] IPQ (Instituto Português da Qualidade), NP EN 933–1. Tests for Geometrical Properties of Aggregates — Part 1; Determination of Particle Size Distribution, Sieving Method; 2000 (in Portuguese).
- [3] BIU Internacional, Ficha técnica do produto FIBRIL 12F, Alverca do Ribatejo, Portugal.
- [4] CEN - EN 1992-1-2. Eurocode 2: Design of concrete structures - Part 1-2: General rules - Structural fire design. Brussels, December 2004.
- [5] Staggs, J. E. J.; Whiteley, R. H. *Modelling the combustion of solid-phase fuels in cone calorimeter experiments. Fire and Materials*, vol. 23, issue 2, 1999, p. 63-69.
- [6] Carlos Balsa et al., “Fire reaction of concrete samples with and without polypropylene fibres – Experimental analysis and numerical validation (in Portuguese)”, full paper, 4th workshop in Urban Fire safety, pp 537-546, ISBN 978-989-97210-2-9, Polytechnic Institute of Bragança and ALBRASCI, Portugal, 6-7 De November 2014.